


Council Sewage Spill Notification Form to the PHS (Block A)

Notifier	Graeme Fox	TLA	Tasman District Council
Date Notified	9 th November 2020	Time Notified	12:00
Date of Spill	9 th November 2020	Time discovered	4:20am
Phone 📞		Phone 📞	

Location and Cause: (Council may embed a map in this section or attach to email when form notified to the PHS)

An as yet unidentified malfunction in the control programme for the Kateriteri sewer pumping system resulted in an overflow at the Keriteriteri control vessel.

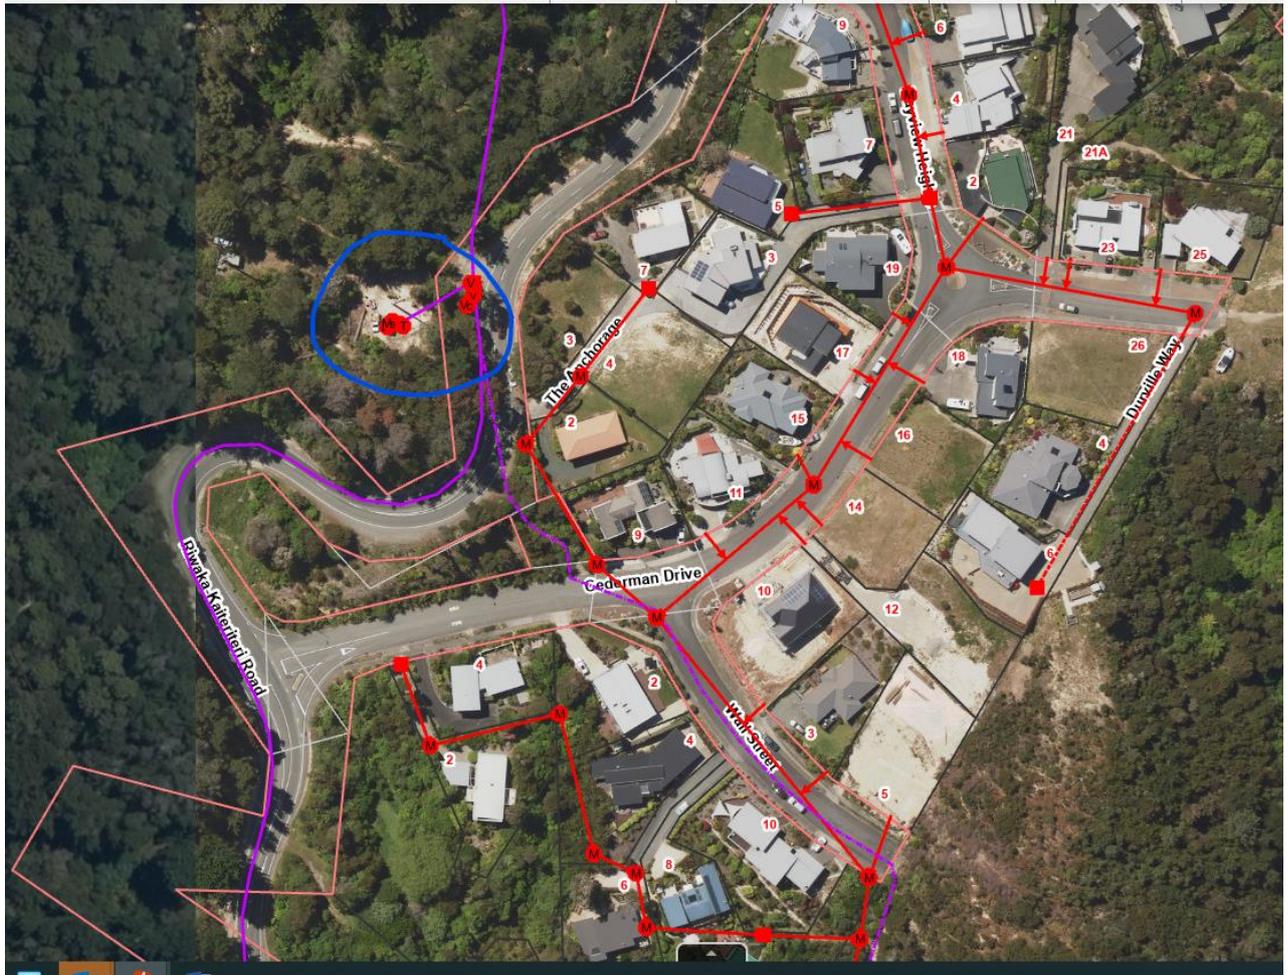

The rainfall in the area would have diluted the overflow and flushed it through to discharge to the sea at Stephens Bay.

Estimated Quantity	30m ³	Estimated Duration	1 hrs	Ongoing (delete one)		N
Weather (delete one)					wet	
Tide conditions at START of spill (delete one)				Falling		
Is it a contact recreation area? (delete one) (Swimming, windsurfing, water skiing, paddle boarding, surfing etc.)				Yes		
Is it a recreational shellfish collection area? (delete one)					no	
Is sampling proposed? (delete one)					no	

Are warning signs proposed (delete one)	Yes	
Is a Public Health Advisory proposed (delete one) (A Council media statement that advises the public to avoid contact or take shell fish for human consumption from a recreational water area, due to a sewage spill)		no

<p>Summary of any risk mitigation action to be taken by Council (Council to complete) Block B</p> <p>Council may complete this block at the same time it completes Block A or subsequently following discussions with the PHS in the case of more complex spills.</p> <p>Investigate and rectify what caused the malfunction in control programme.</p>
